
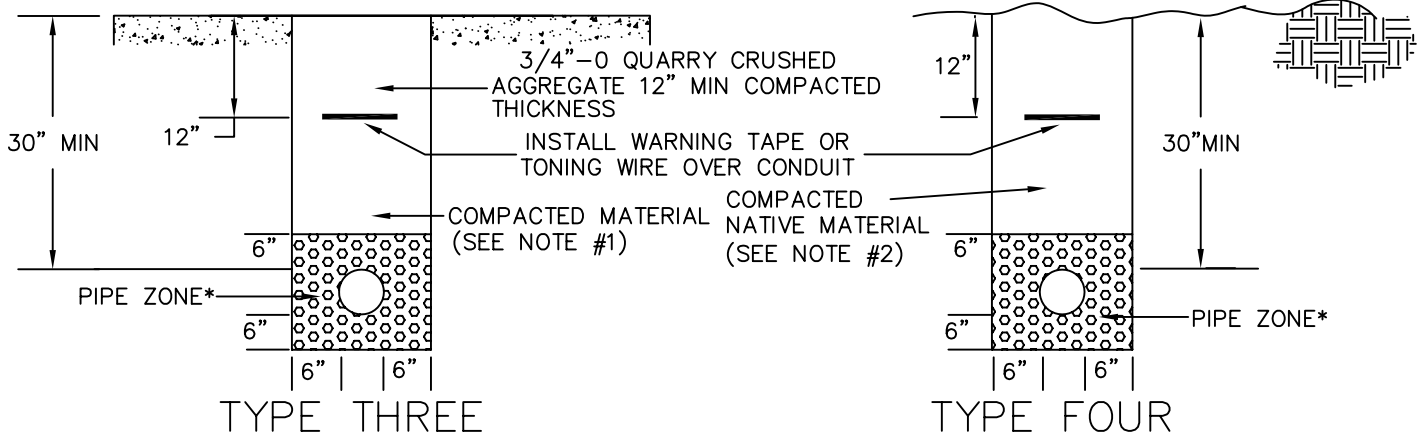


BACKFILL REQUIREMENTS

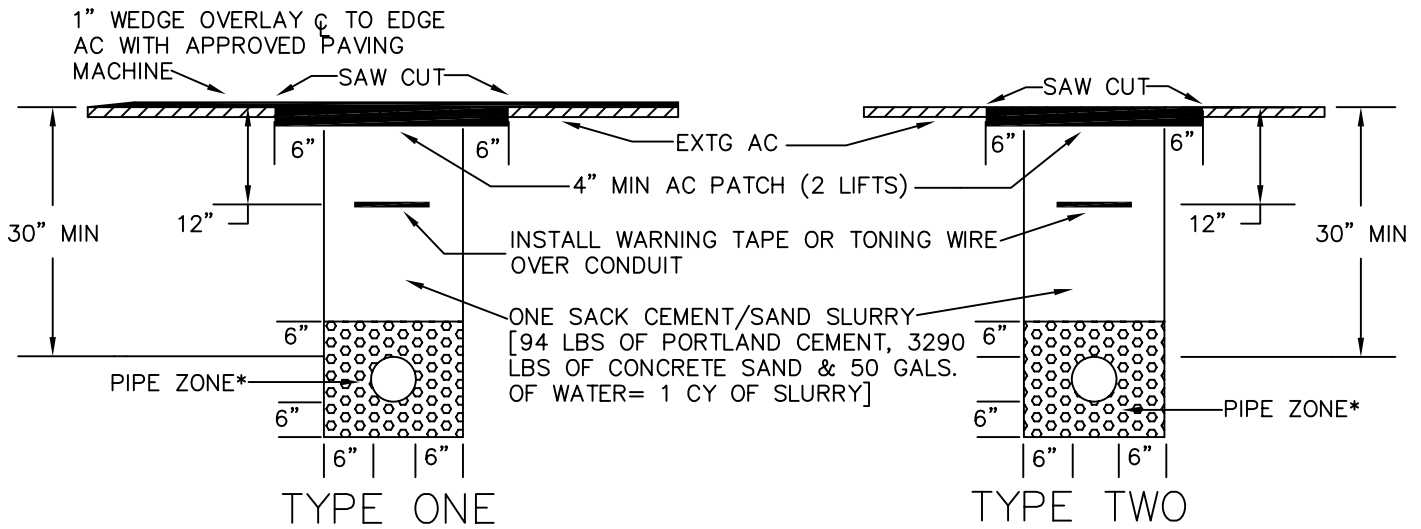

NOTES:

- 1) 3/4"-0 AGGREGATE-REJECT SAND-APPROVED GRANULAR MATERIAL
- 2) TYPE OF BACKFILL SHALL BE DETERMINED BY THE DIRECTOR OF PUBLIC WORKS
- * PIPE ZONE MATERIAL SHALL BE DETERMINED BY THE UTILITY COMPANY INVOLVED

REVISION	APPROVED	DATE	DOUGLAS COUNTY PUBLIC WORKS DEPARTMENT STANDARD DRAWING UNDERGROUND UTILITY LINE	DRAWN <i>SPG</i>	CHECKED <i>CCS</i>
				APPROVED	DATE
				ROBERT G. PAUL, PE, PLS	DIRECTOR
				DRAWING NUMBER	DC401